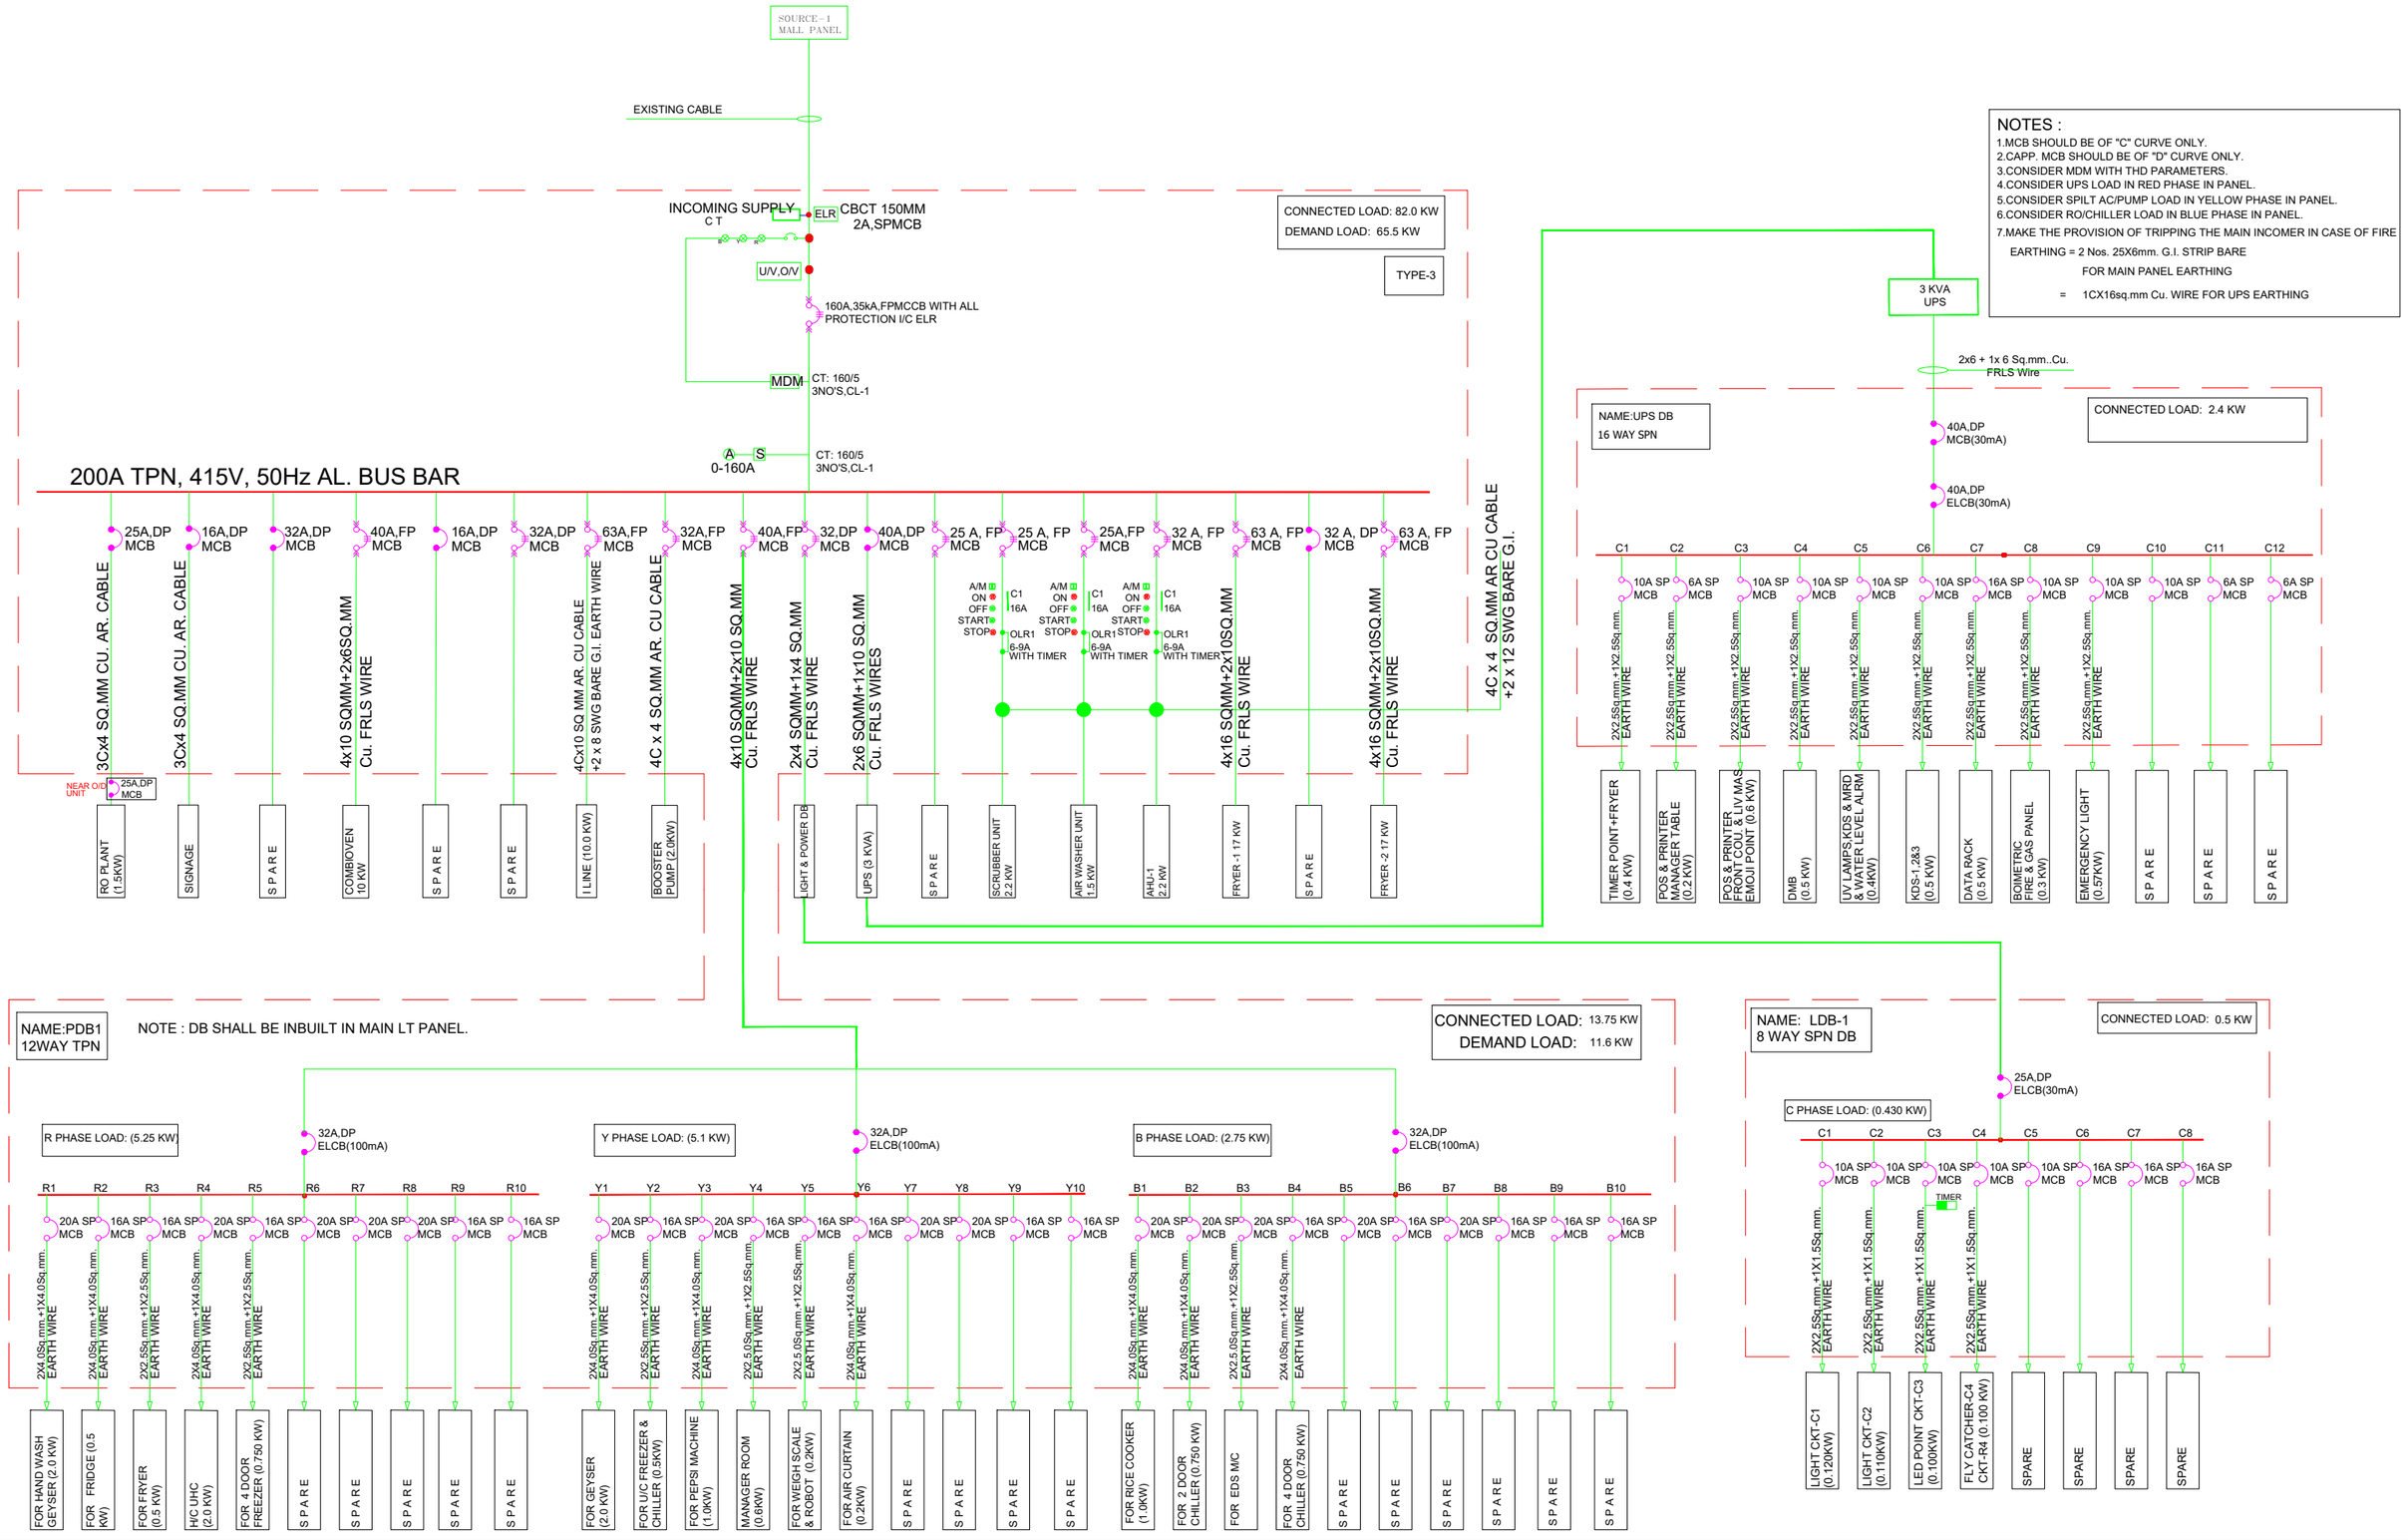

NOTES :

1. MCB SHOULD BE OF "C" CURVE ONLY.
2. CAPP. MCB SHOULD BE OF "D" CURVE ONLY.
3. CONSIDER MDM WITH THD PARAMETERS.
4. CONSIDER UPS LOAD IN RED PHASE IN PANEL.
5. CONSIDER SPILT AC/PUMP LOAD IN YELLOW PHASE IN PANEL.
6. CONSIDER RO/CHILLER LOAD IN BLUE PHASE IN PANEL.
7. MAKE THE PROVISION OF TRIPPING THE MAIN INCOMER IN CASE OF FIRE

EARTHING = 2 Nos. 25X6mm. G.I. STRIP BARE
FOR MAIN PANEL EARTHING
= 1CX16sq.mm Cu. WIRE FOR UPS EARTHING

PROJECT

TACO BELL @ TERMINAL 1, DELHI

CLIENT

TACO BELL

NOTE:

THIS DRAWING & DESIGN IS THE COPYRIGHT OF THE DESIGNER. NO PORTION MAY BE REPRODUCED WITHOUT THE WRITTEN PERMISSION OF THE DESIGNERS

1. ALL DIMENSIONS ARE INCLUDING FINISHES
2. DO NOT SCALE DRAWING.ONLY MENTIONED DIMENSIONS ARE TO BE CONSIDERED.
3. ALL DIMENSIONS MUST BE CHECKED BEFORE COMMENCING WORK ON SITE.
4. ANY DISCREPANCIES SHALL BE BROUGHT UNDER THE NOTICE OF ARCHITECTS PRIOR COMMENCEMENT OF WORK.

REVISION

S.NO.	REMARKS	DATE
1	REV 1	00/00/00
2	REV 2	00/00/00
3	REV 3	00/00/00
4	REV 4	00/00/00
5	REV 5	00/00/00
6	REV 6	00/00/00
7	REV 7	00/00/00
8	REV 8	00/00/00

ARCHITECT / INTERIOR DESIGN

ARCHITECTURE PLANNING INTERIOR FURNITURE
FLAT NO-13 DDA SFS
SLAT POCKET -1 SEC-6 DWARKA,
NEW DELHI-110075
EMAIL:-infoatats@gmail.com
OFF-011-35559249,MOB:9910315171

CONSULTANT

IMS DESIGN CONSULTANTS

No.9,Plot No.886/A,Ward No.8
Mehrauli, New Delhi-110030
Phone - 9871770182, 09868106709
E-mail: imsdesignconsultants@gmail.com

CONSULTANT

RELEASE FOR

INFORMATION	TENDER	CONSTRUCTION
AS BUILT		

TITLE

SLD

DATE	30-11-2023	CHECKED BY	AR. ANKIT
SCALE	NTS	PRINTED BY	-
DWG. NO.	WD-D-08 A	DRAWN BY	CONSULTANT